




DRIVEWAY & APRON PERMIT ADDENDUM (Concrete & Asphalt Standards)

Requirements:

- 1) Minimum CONCRETE pavement thickness:
 - a. Concrete Driveway: 4" concrete over 4" compacted CA6 aggregated base course.
 - b. Concrete Apron/Approach: 6" concrete over 4" compacted CA6 aggregated course base.
 - c. Public Sidewalk within the driveway: 6" P.C. concrete over 2" compacted aggregated course base.
- 2) Minimum ASPHALT pavement thickness:
 - a. Asphalt Driveway: 2" asphalt over 6" compacted CA6 aggregated base course.
 - b. Asphalt Apron/Approach: 3" asphalt over 6" compacted CA6 aggregated base course.
 - c. Public Sidewalk within the driveway: 6" P.C. concrete over 2" compacted aggregated course base.
- 3) All aggregate subbase shall be mechanically compacted (95% proctor).
- 4) All pavement shall be pitched away from the house/dwelling at a slope $\geq 2\%$.
- 5) Public sidewalk must have a cross slope 2% or less.
- 6) Maximum slope of driveway = 8%, maximum slope of approach = 10%.
- 7) A driveway ribbon must be a different impervious surface than the driveway, asphalt and gravel ARE prohibited.
- 8) A driveway ribbon on the property line side of the driveway is permissible if ribbon width is SUBTRACTED from the maximum driveway width.
- 9) A driveway widened beyond the apron/approach width must taper down at a 45-degree angle to match approach width at the sidewalk.
- 10) Top of the -pavement shall be 4" minimum below top of foundation.
- 11) RESTORATION OF ALL DISTURBED AREAS IS REQUIRED BEFORE FINAL INSPECTION.

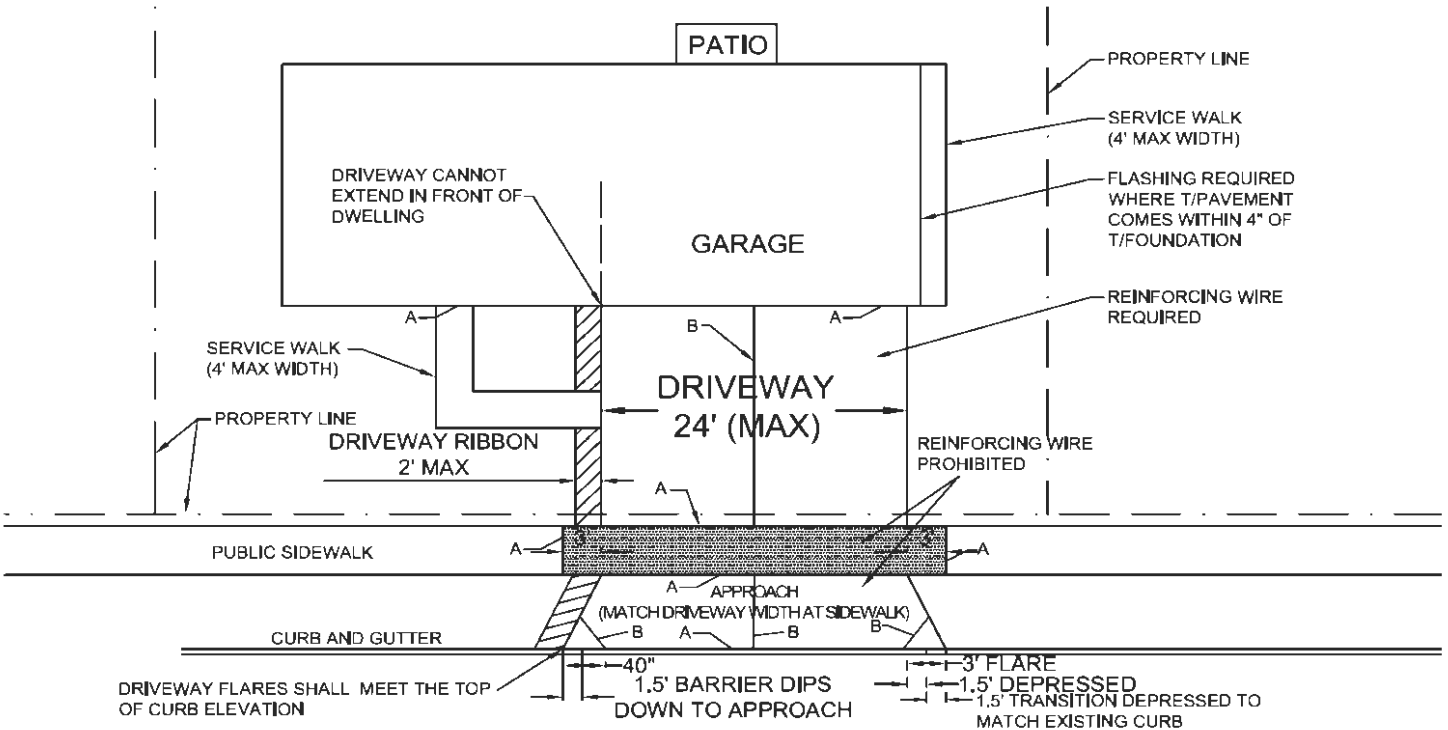

LEGEND:

A = $\frac{1}{2}$ " OR $\frac{3}{4}$ " PREFORMED EXPANSION JOINT (TYPICAL)
 B = TOOLED OR SAWED CONTRACTION JOINTS

I hereby certify that I have read and understand all of the regulations, and I agree to comply with all of the regulations contained herein. I also understand that stamped or colored apron/approach shall NOT be replaced in kind if replaced by the Village.

Signature _____ Date _____

Property Address: _____ Permit #: _____