




## FLAT WORK PAVEMENT PERMIT ADDENDUM (Service Walks, Patios and Public Sidewalks)

**Requirements:**

- 1) Minimum SERVICE WALK pavement thickness:
  - a. Concrete Service Walk: 4" concrete over 4" compacted CA6 aggregated base course.
  - b. Paver Service Walk: Pavers over 4" compacted CA6 aggregated base course.
  
- 2) Minimum PATIO pavement thickness:
  - a. Concrete Service Walk: 4" concrete over 4" compacted CA6 aggregated base course.
  - b. Paver Service Walk: Pavers over 4" compacted CA6 aggregated base course.
  
- 3) Minimum PUBLIC SIDEWALK pavement thickness:
  - a. Public Sidewalk: 6" concrete over 2" compacted CA6 aggregated base course.

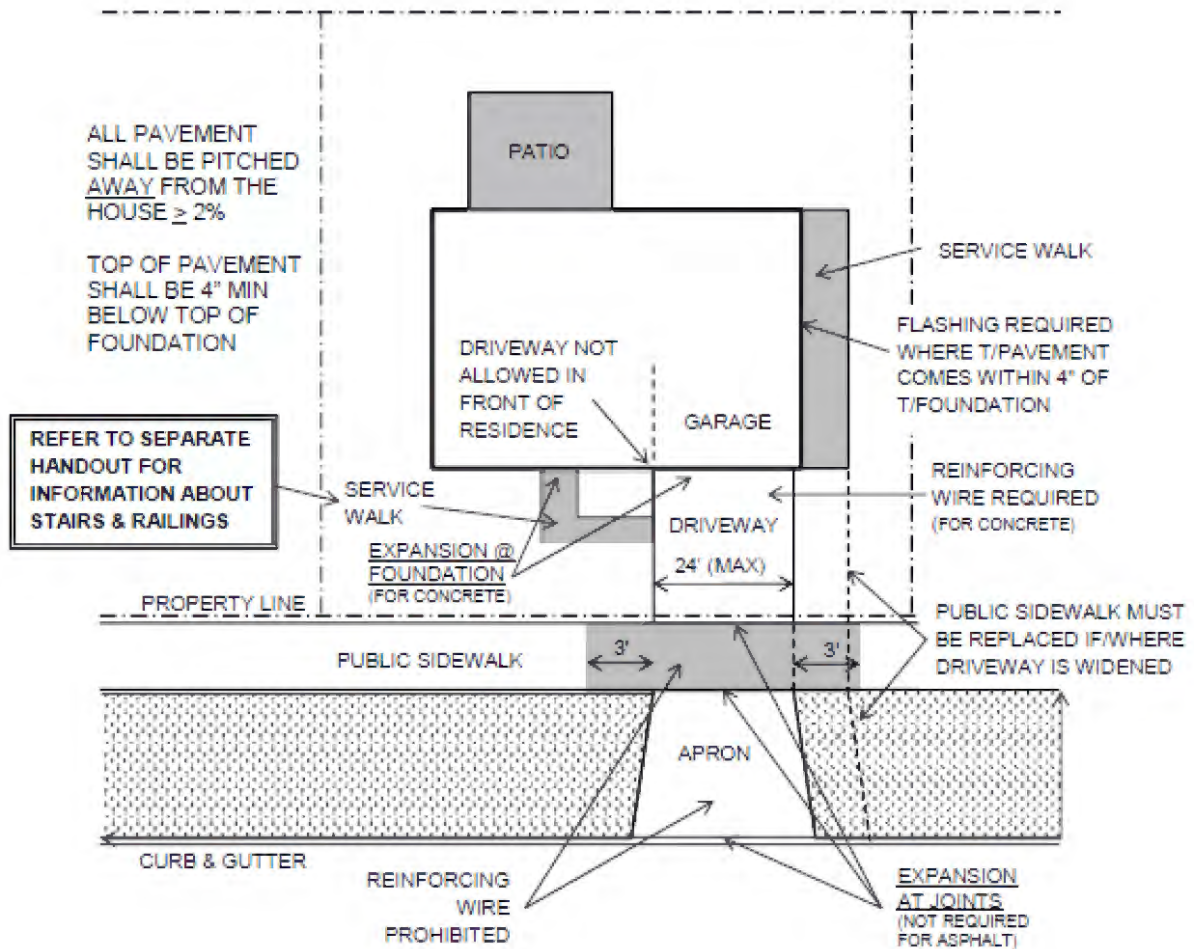

I hereby certify that I have read and understand all of the regulations, and I agree to comply with all of the regulations contained herein. I also understand that stamped or colored apron/approach shall NOT be replaced in kind if replaced by the Village.

Signature \_\_\_\_\_ Date \_\_\_\_\_

Property Address: \_\_\_\_\_ Permit #: \_\_\_\_\_